


Stewart Avenue

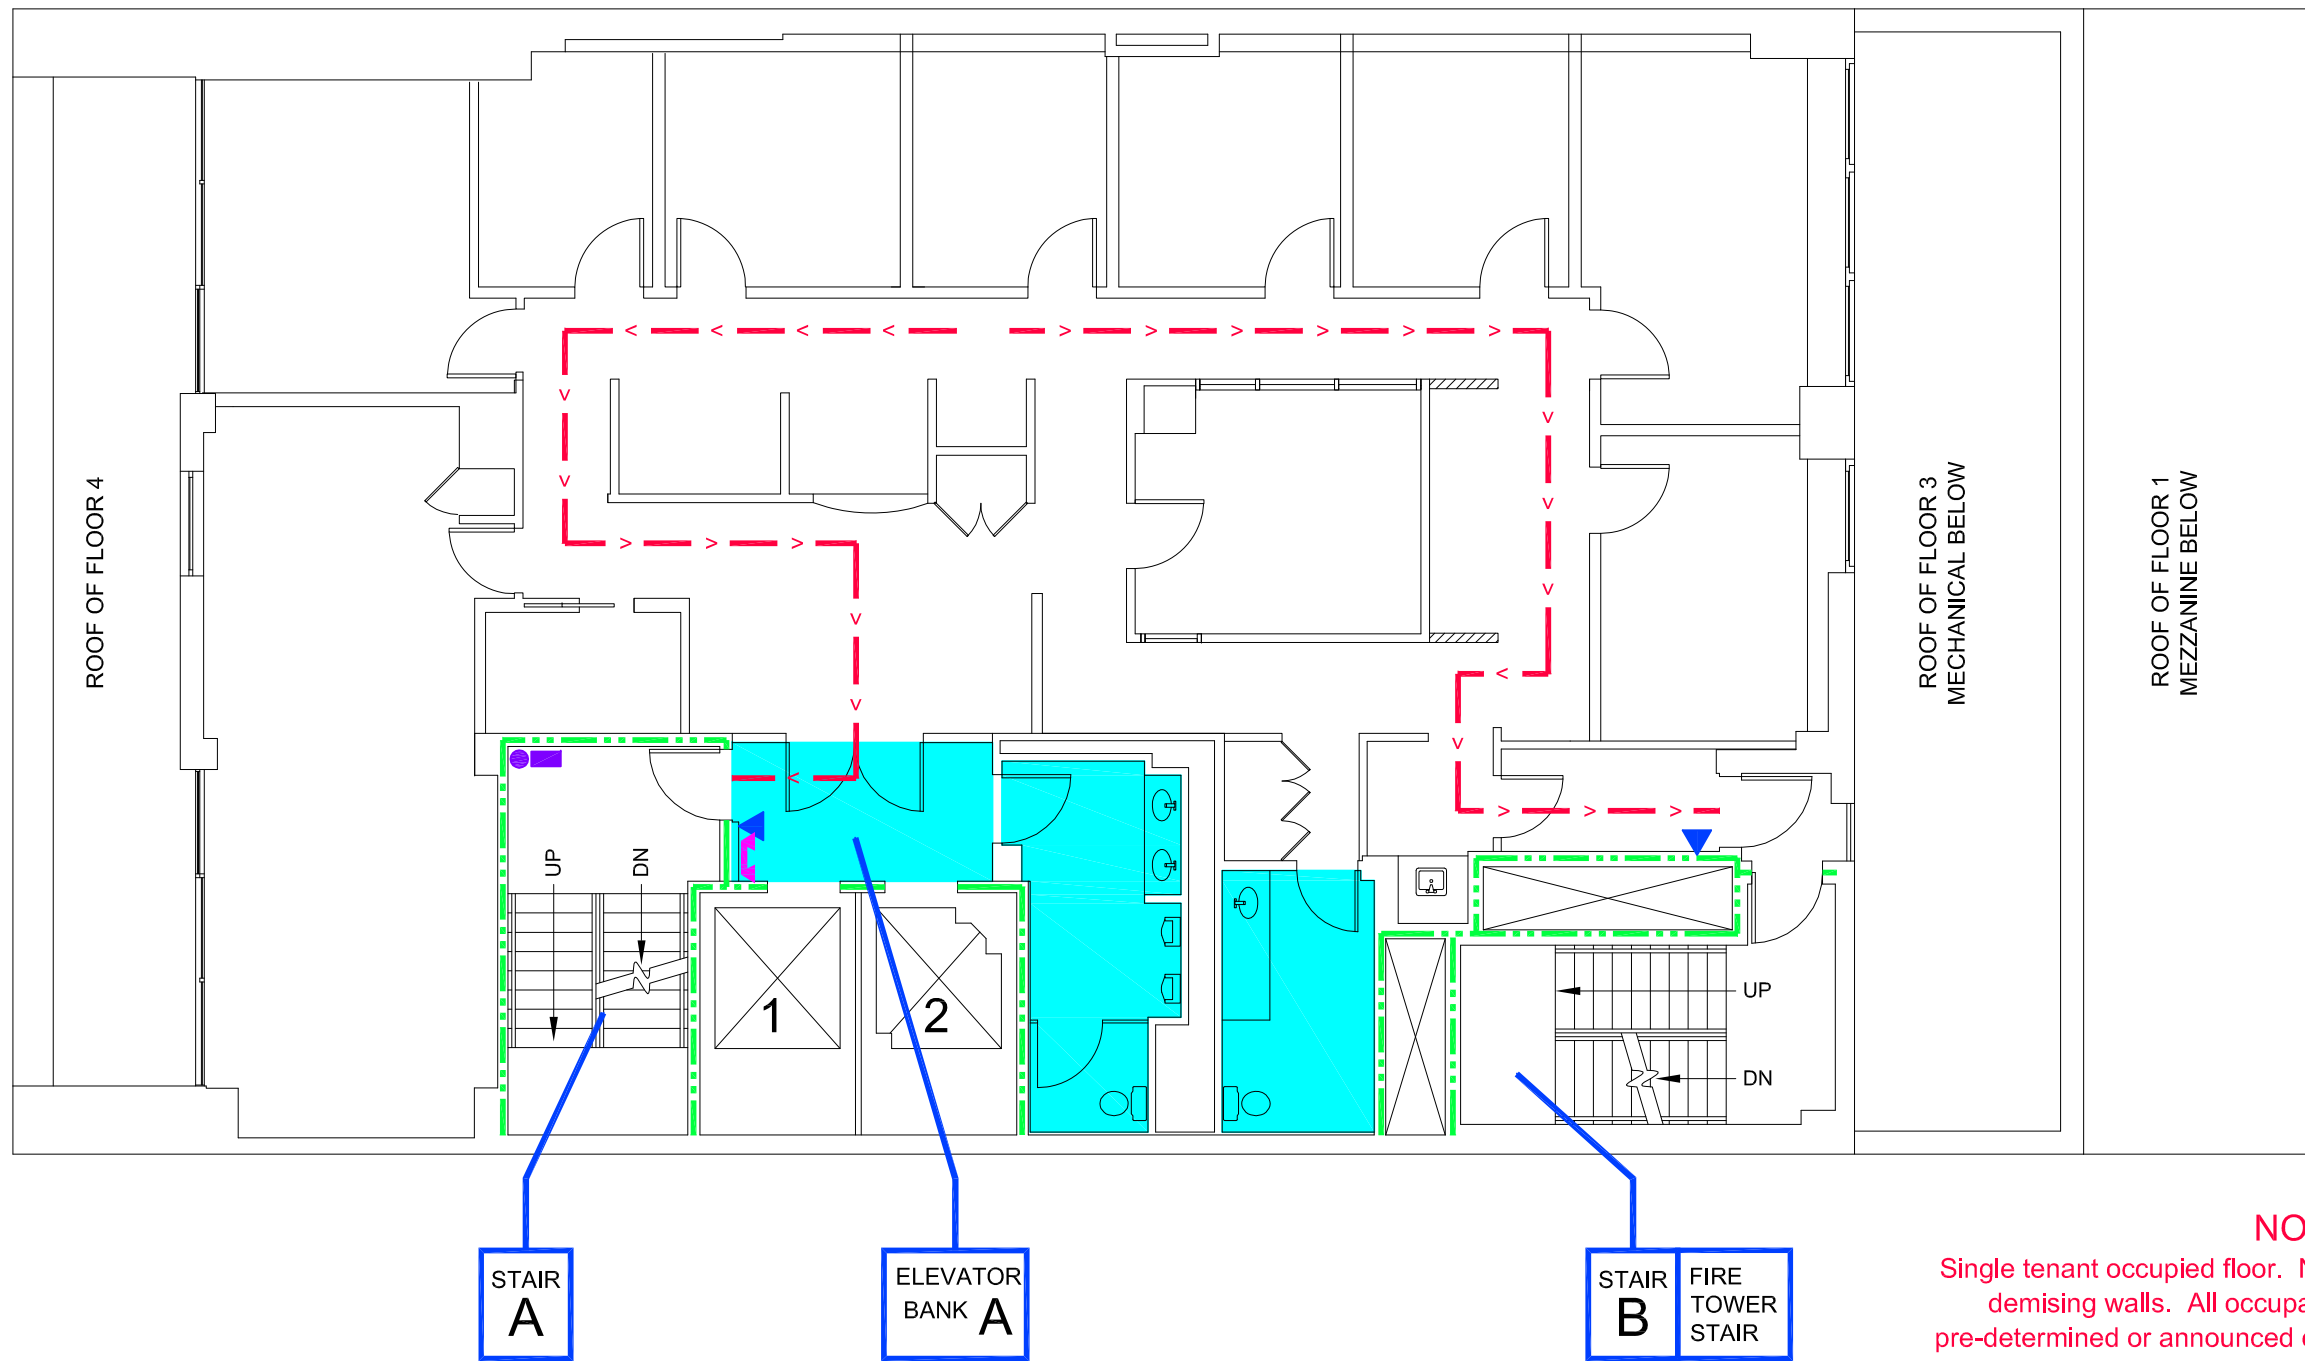

NOTE:
 Single tenant occupied floor. No defined fire rated corridor or demising walls. All occupants respond to the nearest pre-determined or announced designated area by the shortest possible route available.
 Floor not sprinkler protected.

	Auxiliary Hose Rack
	Evacuation Route
	Permanent Partition
	Relocation Area
	Non-Sprinklered Area
	Fire Barrier
	Fire Department Connection
	Manual Alarm
	Standpipe Hose Outlet
	Fire Warden Phone
	Fire Command Station
	Sprinkler Control Valve
	Main Control Valve

Comprehensive Fire Safety and Evacuation and Emergency Action Plan 11 Stewart Avenue

Prepared by PlanData Systems Corp. 800-757-61DG

Floor 5



FL-5